




## CHULA VISTA FIRE DEPARTMENT

FIRE PREVENTION DIVISION

# COMMERCIAL KNOX BOX REQUIREMENTS

## **Multi-Tenant** – *For Buildings without a Fire Control Room*

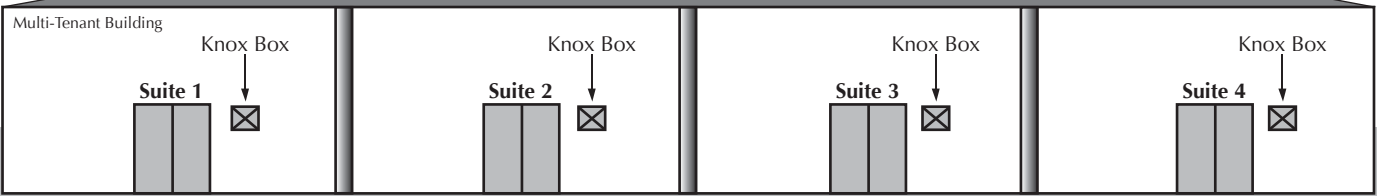

Multi-Tenant Building

Knox Box

Suite 1

Suite 2


Suite 3

Suite 4

### Main Entrance/Street Facing Side

- Located no further than 2 ft. from main entrance of each suite
- Minimum height = 5 ft. / Maximum = 6 ft.
- Knox Box model 3271 (recessed w/ hinged door)

- Multi-tenant commercial buildings are required to provide a Knox Box (model 3271) for each tenant space
- Some buildings will require additional Knox devices
- The “Fire Department” Alert Decal is to be mounted on the door or frame of the suite’s entrance
- Keys to be placed into the Knox box will be determined by CVFD Fire Prevention Staff (i.e. master key(s), FACP, SDG&E, keys for appliance operation, etc.)
- Required keys shall be secured in knox box/vault prior to final occupancy certification
- Knox devices can be ordered and purchased at [www.knoxbox.com](http://www.knoxbox.com)
- Install per manufacturer’s instructions

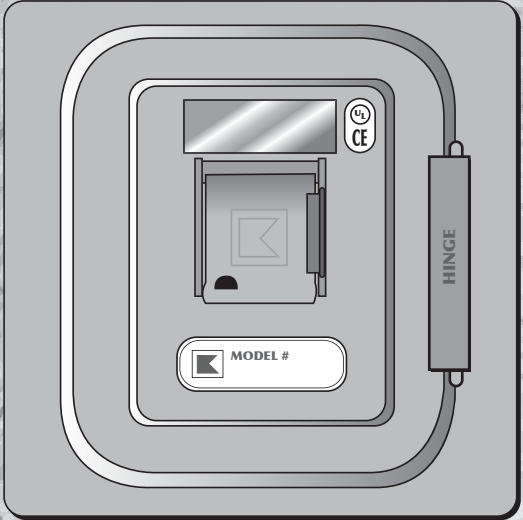

HINGE

MODEL #

Knox Box